


# Class 0 Summary Report

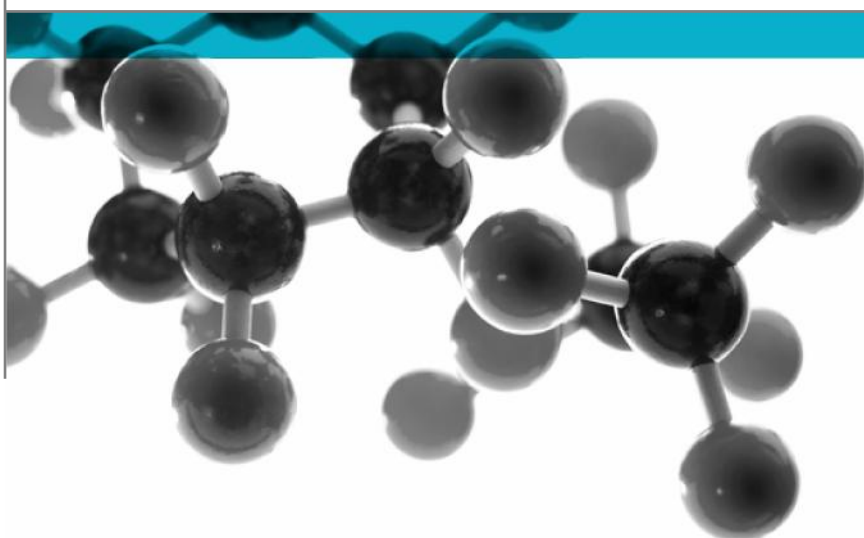

**Including Opinion Of Compliance With The Requirements For A Class 0 Surface As Defined In Paragraph A13(b) Of Approved Document B (Volumes 1 & 2), (2006 Edition) 'Fire Safety' To The Building Regulations 2000**

**Date:** 17<sup>th</sup> June 2014

**Issue No.:** 1

Page 1

A Report To: Fiberlock Technologies Inc.

Document Reference: 341761

**Testing  
Advising  
Assuring**

## Executive Summary

**Objective** To assess the results of tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7:1997, obtained on specimens of the following product and to provide an opinion of compliance with the requirements for a Class 0 surface, as defined in Approved Document B to the Building Regulations 2000.



Generic Description	Product reference	Thickness	Weight per unit area or density
A water-based coating product applied to a calcium silicate substrate	"SerpiMastic Sprayable - Part #2419"	13.2mm *	12.7kg/m <sup>2</sup> *
<b>Individual components used to manufacture composite:</b>			
Coating product (test face)	"Part #2419"	1mm	Not stated
Calcium silicate	"Promat-Brandschutzbauplatten; Promatect-H"	12mm	870kg/m <sup>3</sup>
<b>*Determined by Exova Warringtonfire</b>			
<b>Please see page 5 of this test report for the full description of the product tested</b>			

**Test Sponsor** Fiberlock Technologies Inc., 150 Dascomb Road, Andover, Massachusetts 01810, USA.

**Opinion:** We consider the results of the tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7: 1997, demonstrate that the product, as tested, complies with the requirements for Class 0, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.

**Date of Test** 30<sup>th</sup> May 2014

## Signatories

	
Responsible Officer C. Meachin * Technical Officer	Authorised S. Deeming * Operations Manager

\* For and on behalf of **Exova Warringtonfire**.

Report Issued: 17<sup>th</sup> June 2014

This version of the report has been produced from a .pdf format electronic file that has been provided by Exova Warringtonfire to the sponsor of the report and must only be reproduced in full. Extracts or abridgements of reports must not be published without permission of Exova Warringtonfire

Document No.:	341761	Page No.:	2 of 7
Author:	C. Meachin	Issue Date:	17 <sup>th</sup> June 2014
Client:	Fiberlock Technologies Inc.	Issue No.:	1

<b>CONTENTS</b>	<b>PAGE NO.</b>
<b>EXECUTIVE SUMMARY .....</b>	<b>2</b>
<b>SIGNATORIES.....</b>	<b>2</b>
<b>TEST DETAILS.....</b>	<b>4</b>
<b>DESCRIPTION OF TEST SPECIMENS.....</b>	<b>5</b>
<b>CLASSIFICATION .....</b>	<b>6</b>
<b>REVISION HISTORY .....</b>	<b>7</b>

## Test Details

---

**Terms Reference**      **Of** To assess the results of tests to BS 476:Part 6:1989+A1: 2009 and BS 476:Part 7:1997, obtained on specimens of a product and to provide an opinion of compliance with the requirements for a Class 0 surface, as defined in Approved Document B to the Building Regulations 2000.

**Introduction**      Specimens of a product have been tested in accordance with the test methods specified in BS 476: Part 6: 1989+A1: 2009 'Method of test for fire propagation for products' and BS 476: Part 7: 1997 'Method of test to determine the classification of the surface spread of flame of products'. The results of the tests are fully reported in the **Exova Warringtonfire** test reports No's. 338604 and 338605.

This summary test report has been prepared at the request of the sponsor and relates the results of the tests to the requirements for a Class 0 surface of a material or composite product, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.

This summary should be read in conjunction with, and not accepted as a substitute for, the **Exova Warringtonfire** test reports No's. 338604 and 338605. Those test reports may include additional information which may be relevant to the assessment of the potential fire hazard of the product.

**Face subjected to tests**      The specimens were mounted in the test positions such that the coated face was exposed to the heating conditions of the tests.

**Results of test**      The following results were obtained for the specimens, which were tested.

<b>BS 476: Part 6: 1989</b>	Fire propagation index, I	=	3.8
	subindex, $i_1$	=	0.3
	subindex, $i_2$	=	2.9
	subindex, $i_3$	=	0.6

**BS 476: Part 7:  
1997**      Class 1 surface spread of flame

The test results relate only to the behaviour of the test specimens of the product under the particular conditions of the test, they are not intended to be the sole criterion for assessing the potential hazard of the product in use.

## Description of Test Specimens

The description of the specimens given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

General description		A water-based coating product applied to a calcium silicate substrate
Thickness of composite including substrate		13.2mm (determined by <b>Exova Warringtonfire</b> )
Weight per unit area of composite including substrate		12.7kg/m <sup>2</sup> (determined by <b>Exova Warringtonfire</b> )
Product reference of overall coating		"SerpiMastic Sprayable - Part #2419"
Coating product (test face)	Generic type	Water-based, high solids, asbestos bridging encapsulant/mastic coating
	Product reference	"Part #2419"
	Name of manufacturer	Fiberlock Technologies, Inc.
	Colour reference	"Off White"
	Number of coats	1
	Application thickness per coat	1 mm
	Application rate per coat	0.4m <sup>2</sup> /l
	Application method	Airless spray
	Flame retardant details	<b>See Note 1 below</b>
Curing process per coat		14 days minimum
Calcium silicate	Trade name	"Promat-Brandschutzbauplatten; Promatect-H"
	Generic type	Calcium silicate based board
	Name of manufacturer	Promat
	Thickness	12mm
	Density	870kg/m <sup>3</sup>
Flame retardant details		This component is inherently flame retardant
Brief description of manufacturing process		Dispersion and mixing of resins, pigments, and additives to form a water based coating

**Note 1: The sponsor was unwilling to provide this information.**

## Classification

---

### Opinion

We consider the results of the tests detailed above demonstrate that the product, as tested, complies with the requirements for Class 0, as defined in paragraph A13(b) of Approved Document B, 'Fire Safety', to the Building Regulations 2000.

### Validity of opinion

This opinion is based on the requirements of the Building Regulations at the date of this report. If the Building Regulations are revised or amended in any way subsequent to that date, care must be taken to ensure that this opinion is not invalidated by those revisions or amendments.

The opinion has been formulated on the assumption that the specimens are representative of the product in practice. **Exova Warringtonfire** was not involved in any sampling or selection procedures which would confirm this or in any audit testing which would provide confidence in the consistency of the product in the tests.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of **Exova Warringtonfire**.

## Revision History

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	